



1 SECOND FLOOR PLAN - HVAC NEW CONSTRUCTION
 1/8" = 1'-0"

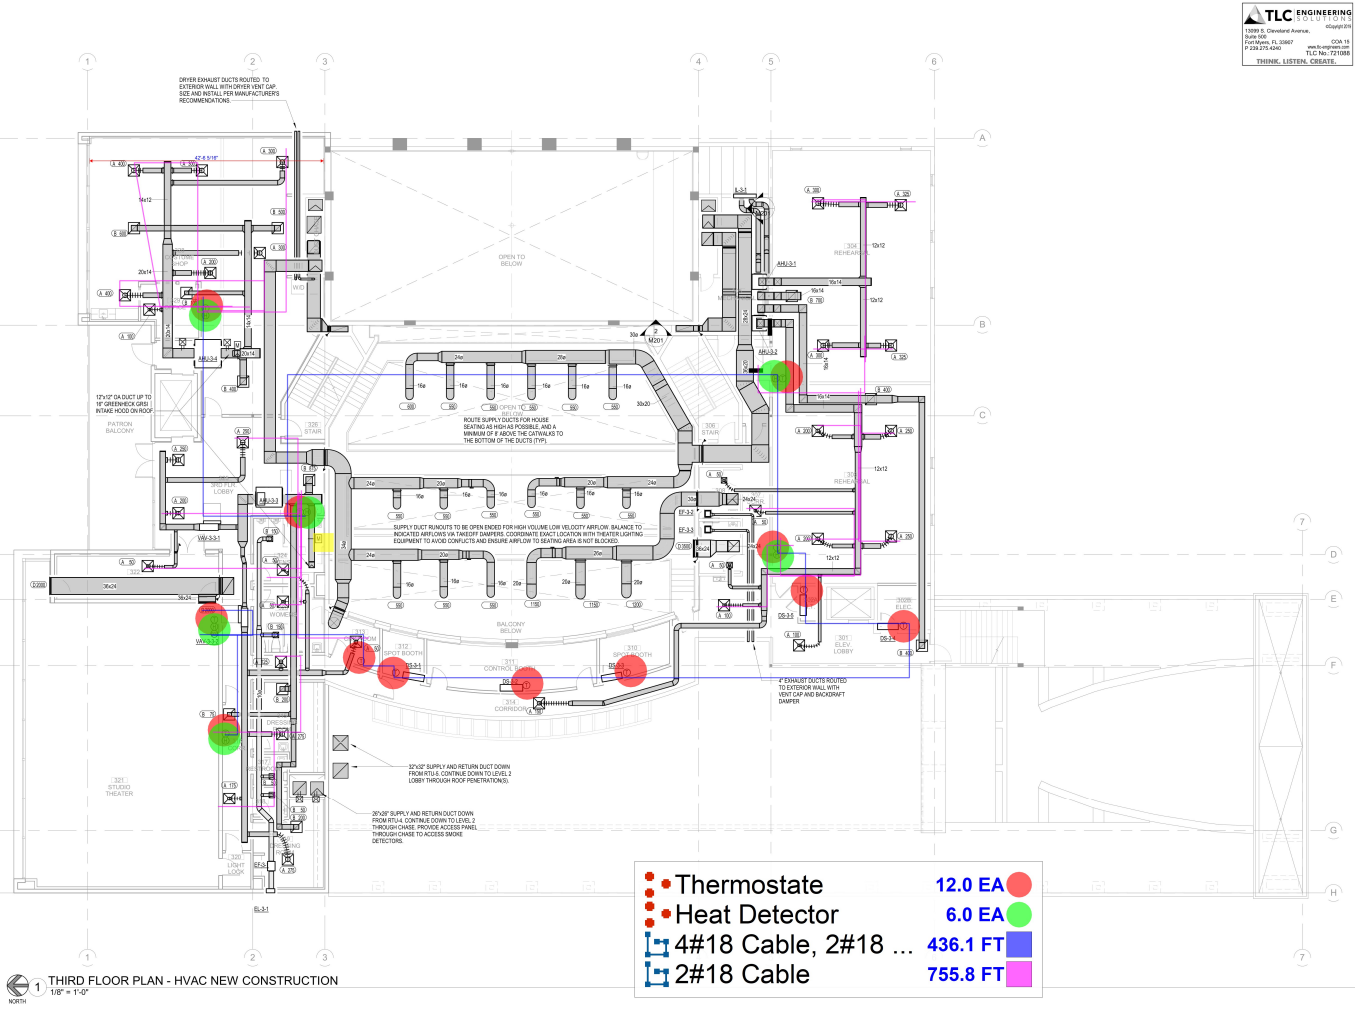

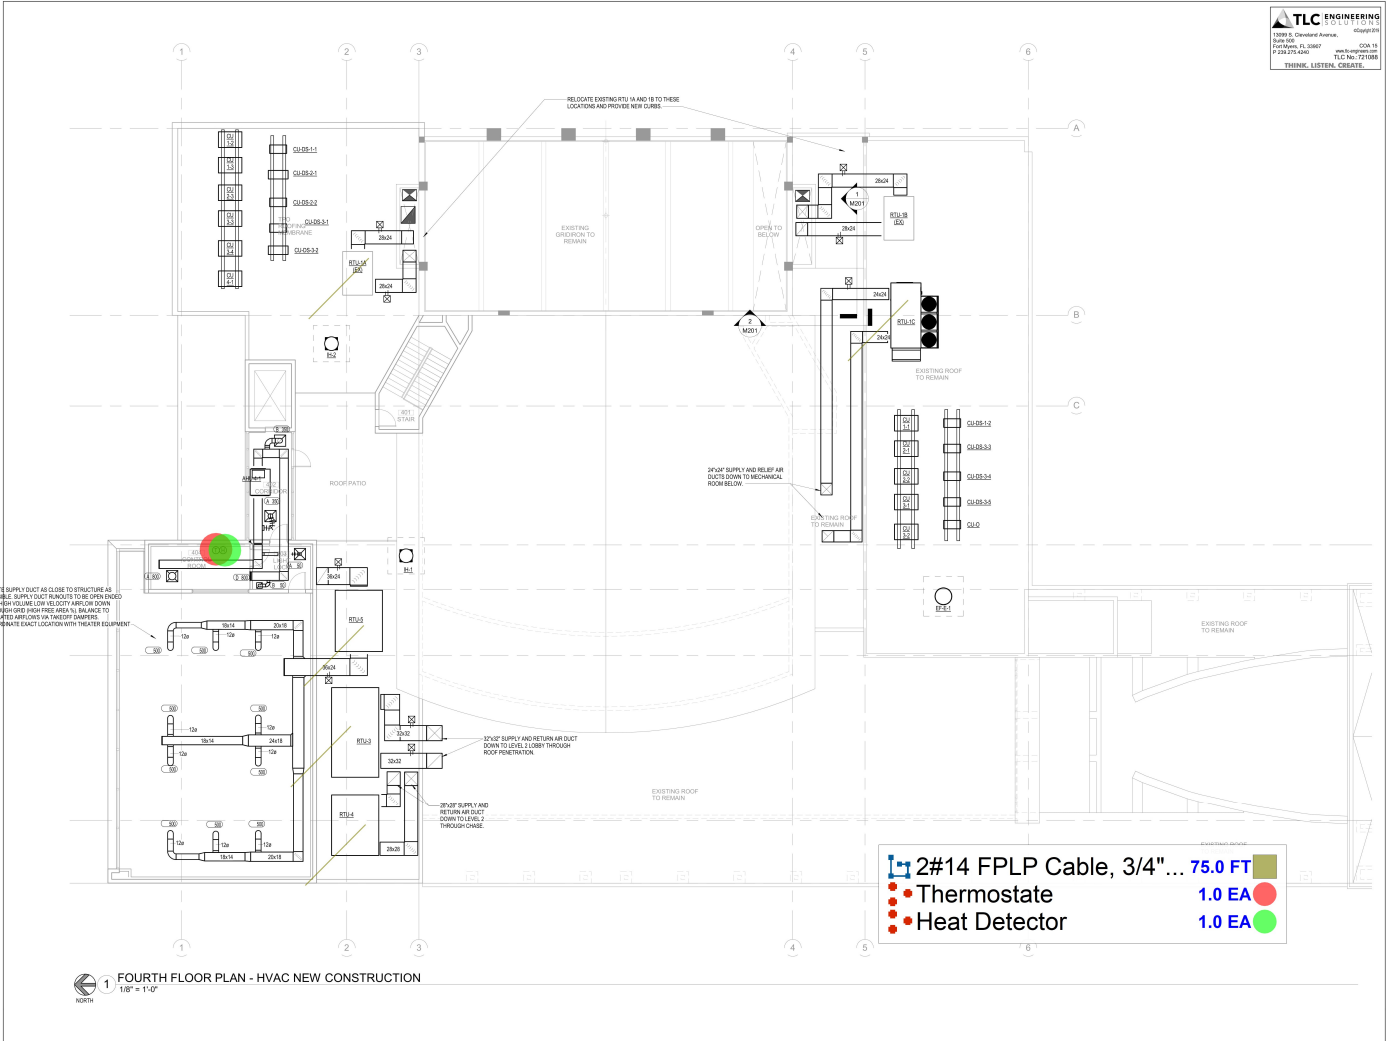

1 FOURTH FLOOR PLAN - HVAC NEW CONSTRUCTION
 1/8" = 1'-0"

■	2#14 FLP Cable, 3/4"...	75.0 FT
●	Thermostat	1.0 EA
●	Heat Detector	1.0 EA

TLC ENGINEERING
 13991 S. Cleveland Avenue, Suite 100
 Fort Myers, FL 33907
 P: 239.733.1340 F: 239.733.1341
 www.tlceng.com
 REGISTERED PROFESSIONAL ENGINEERS
 STATE OF FLORIDA
 LICENSE NO. 12018
 LICENSE NO. 12019
 LICENSE NO. 12020
 LICENSE NO. 12021
 LICENSE NO. 12022
 LICENSE NO. 12023
 LICENSE NO. 12024
 LICENSE NO. 12025
 LICENSE NO. 12026
 LICENSE NO. 12027
 LICENSE NO. 12028
 LICENSE NO. 12029
 LICENSE NO. 12030
 LICENSE NO. 12031
 LICENSE NO. 12032
 LICENSE NO. 12033
 LICENSE NO. 12034
 LICENSE NO. 12035
 LICENSE NO. 12036
 LICENSE NO. 12037
 LICENSE NO. 12038
 LICENSE NO. 12039
 LICENSE NO. 12040
 LICENSE NO. 12041
 LICENSE NO. 12042
 LICENSE NO. 12043
 LICENSE NO. 12044
 LICENSE NO. 12045
 LICENSE NO. 12046
 LICENSE NO. 12047
 LICENSE NO. 12048
 LICENSE NO. 12049
 LICENSE NO. 12050

CORBAN
 ARCHITECTURE/PLANNING/SUSTAINABILITY
 DAVID CORBAN, ARCHITECT, AIA / 1042 6th Ave. N., Naples, FL 34102
 P: 239.267.5528 / dcorban@corban.com / www.corban.com

David Corban Architects, PLLC, is showing as the architect of record for this project. These drawings are preliminary and are not to be used for construction without the written consent of the architect. The architect shall not be responsible for any errors or omissions in these drawings or for any consequences arising therefrom. The architect shall not be responsible for any construction or for any consequences arising therefrom. The architect shall not be responsible for any construction or for any consequences arising therefrom. The architect shall not be responsible for any construction or for any consequences arising therefrom.




This form has been digitally signed and sealed by David Corban, P.E. No. 9983, State of Florida, Mechanical, License No. 12018. The seal is subject to the rules and regulations of the State Board of Professional Regulation. The seal is not valid if the seal is not properly signed and sealed and the signature is not written in blue ink.

ADDITIONS AND RENOVATIONS TO:
TNP | THE NAPLES PLAYERS
 CITY OF NAPLES, FL

ROOF PLAN NEW CONSTRUCTION - HVAC

PROJECT: 2018-16
 DATE: 12/16/22

M105

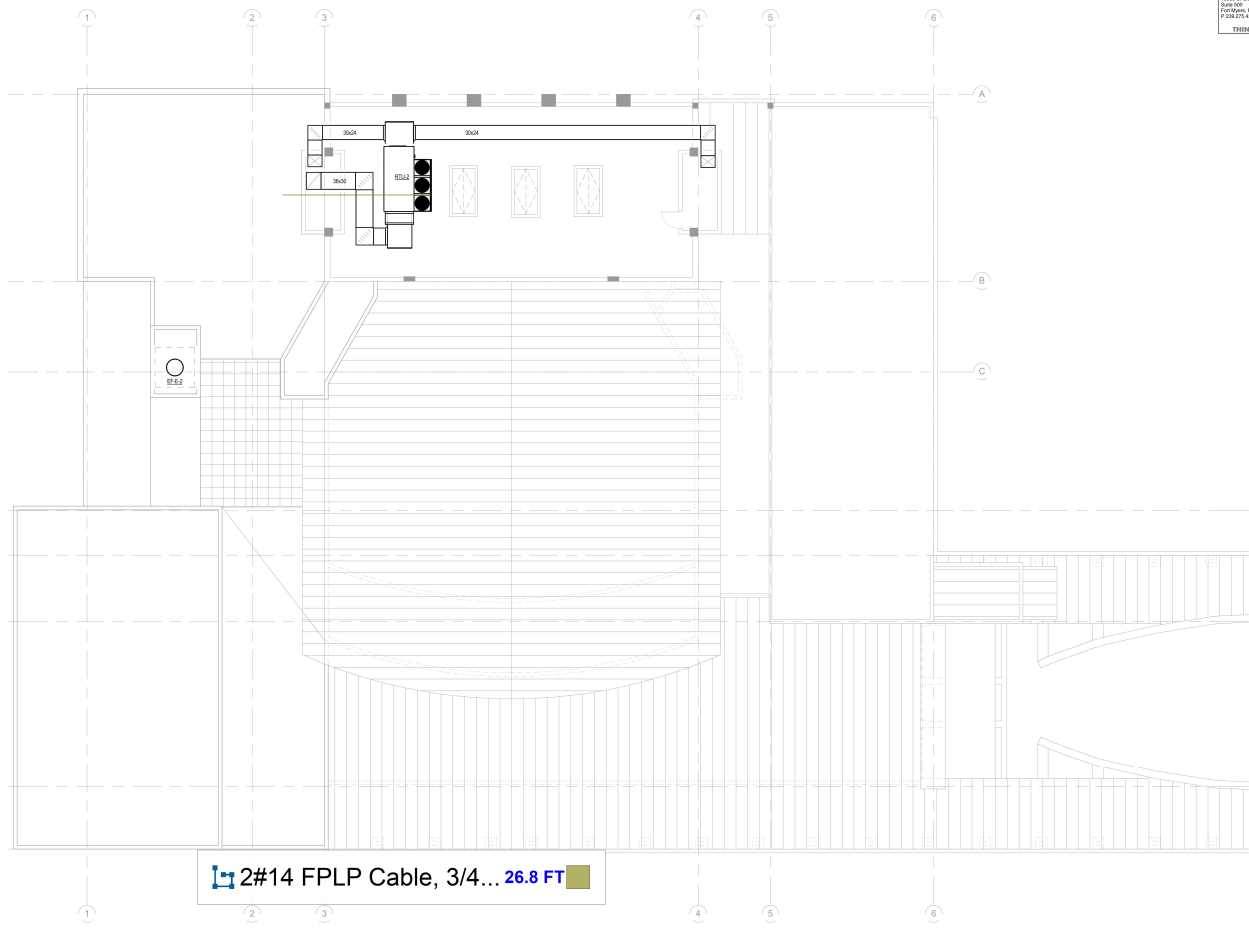

ROOF PLAN - HVAC NEW CONSTRUCTION
 1/8" = 1'-0"